



REPORT

3933 US ROUTE 11 CORTLAND, NEW YORK 13045

Order No. 3151742

Revised Issue Date: January 25, 2010

Date: May 24, 2008

REPORT NO 3151742CRT-001

**IMPACT SOUND TRANSMISSION TEST AND CLASSIFICATION OF
LM FLOORING ½ INCH ENGINEERED HARDWOOD OVER
IMPACTA-REGUPOL PROBASE 3MM UNDERLAYMENT
ON A CONCRETE FLOOR WITH A DROP CEILING**

RENDERED TO

**SOUND SEAL
50 H. P. ALMGREN DRIVE
AGAWAM, MA 01001**

Revision Note: Change in product name.

INTRODUCTION

This report gives the results of an Impact Sound Transmission test and the determination of the Impact Insulation Class of LM Flooring ½ inch Engineered Hardwood over IMPACTA-REGUPOL PROBASE 3MM underlayment. The underlayment and engineered hardwood were selected and supplied by the client and received at the laboratories on April 10, 2008. The samples appeared to be in a new, unused condition

AUTHORIZATION

Signed Intertek Quotation No. 500084548.

TEST METHOD

The floor system was tested in general accordance with the American Society for Testing and Materials designation ASTM E492-04, "Standard Test Method for Laboratory Measurement of Impact Sound Transmission through Floor-Ceiling Assemblies Using the Tapping Machine". It was classified in accordance with ASTM E989-89 (Re-approved 1999), entitled, "Standard Classification for Determination of Impact Insulation Class (IIC)".

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to copy or distribute this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program. Measurement uncertainty budgets have been determined for applicable test methods and are available upon request.



GENERAL

The method is designed to measure the impact sound transmission performance of a floor-ceiling assembly, in a controlled laboratory environment. A standard tapping machine (Bruel & Kjaer Type 3207) was placed at four positions on a test floor that forms the horizontal separation between two rooms, one directly above the other. The data obtained was normalized to a reference room absorption of 10 square meters in accordance with the test method.

The standard also prescribes a single-figure classification rating called "Impact Insulation Class, IIC" which can be used by architects, builders and code authorities for acoustical design purposes in building construction.

The IIC is obtained by matching a standard reference contour to the plotted normalized one-third octave band sound pressure levels at each test frequency. The greater the IIC rating, the lower the impact sound transmission through the floor-ceiling assembly

DESCRIPTION OF THE FLOOR/CEILING ASSEMBLY

The floor/ceiling assembly system consisted of a 6 inch thick concrete floor with a drop ceiling below forming the horizontal separation between two rooms, one directly above the other. The drop ceiling consisted of 14 inch deep steel bar joists spaced 38 inches on center. The ceiling construction consisted of 2 x 4 inch wood bolted to the bar joists. The 2 x 4 inch wood was spaced 24 inches on center. Resilient channels (1/2 inch single leaf) were positioned on 16 inch centers between the furring strips and the 1/2 inch gypsum board. Sound attenuation batts (U.S.G. Thermofiber), four (4) inches in thickness were placed between the joists in the formed cavity. The receiving room below measured 1440 cubic feet.

TEST SPECIMEN

The test specimen from bottom to top consisted of a layer of Sika T-35 glue, IMPACTA-REGUPOL PROBASE 3MM rubber underlayment, another layer of Sika T-35 glue with LM Flooring 1/2 inch thick engineered hardwood (5 inches wide by 48 inches in length).



RESULTS OF TEST

LM Flooring 1/2 inch Engineered Hardwood over IMPACTA-REGUPOL PROBASE 3MM underlayment

The data obtained in the room below the panel normalized to $A_o = 10$ square meters, is as follows:

<u>1/3 Octave Band Center Frequency Hz</u>	<u>1/3 Octave Band Sound Pressure Level dB re 0.0002 Microbar</u>
100	58
125	55
160	52
200	54
250	55
315	57
400	57
500	53
630	47
800	42
1000	38
1250	35
1600	30
2000	26
2500	24
3150	19
Impact Insulation Class (IIC)	60


The 95% uncertainty level for each tapping machine location is less than 3 dB for the 1/3 octave bands centered in the range from 100 to 400 Hz and less than 2.5 dB for the bands centered in the range from 500 to 3150 Hz.

For the floor/ceiling construction, the 95% uncertainty limits (ΔL_n) for the normalized sound pressure levels were determined to be less than 2 dB for the 1/3 octave bands centered in the range from 100 to 3500.



LM Flooring 1/2 inch Engineered Hardwood over IMPACTA-REGUPOL
PROBASE 3MM underlayment

Impact Insulation Class

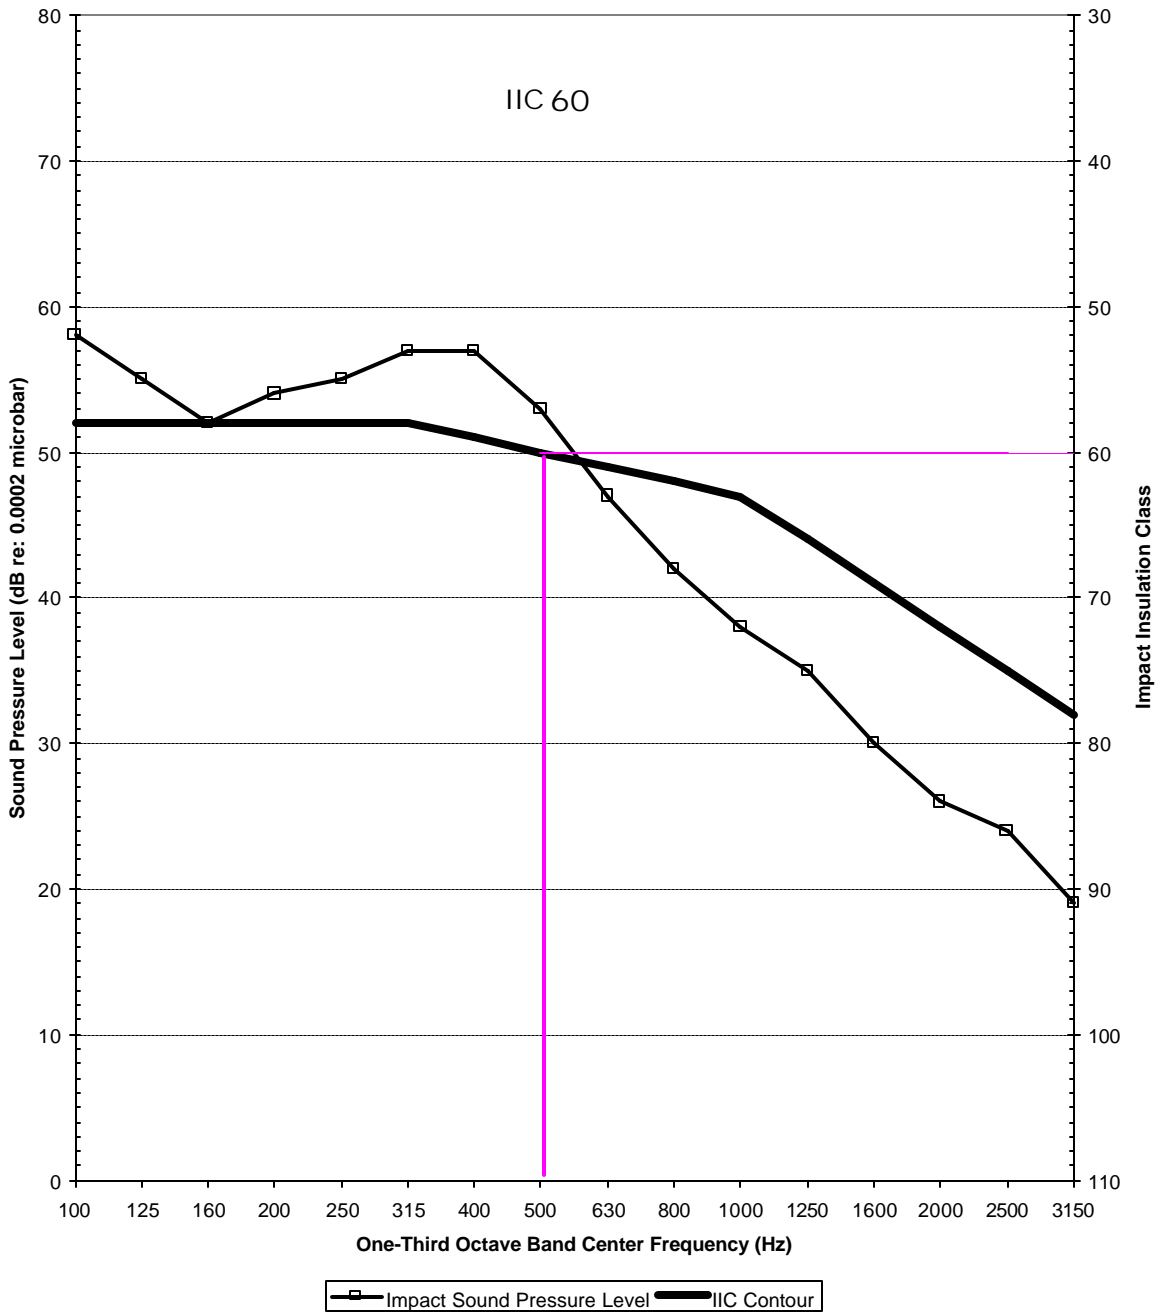

SOUND SEAL



REMARKS

1. Aging Period: 24 hours per glue layer making total aging period 48 hours
2. Ambient Temperature: 70°F
3. Relative Humidity: 32%

CONCLUSION

The test method employed for this test has no pass-fail criteria, therefore, the evaluation of the test results is left to the discretion of the client.

Date of Test: May 14, 2008

Report Approved by:

A handwritten signature in black ink that reads "Brian Cyr".

Brian Cyr
Engineer
Acoustical Testing

Report Reviewed By:

A handwritten signature in black ink that reads "James R. Kline".

James R. Kline
Engineer/Quality Supervisor
Acoustical Testing

Attachments: None